



District Level Water Analysis Laboratory


UP Jal Nigam (Rural), Bulandshahr

TEST REPORT

UTR NO:	:	T 9249	
Sample receipt Date:	:	21/04/2025	
Customer/Party Name	:	SAINT MOMINA SCHOOL IMLIYA	
Address	:	SAINT MOMINA SCHOOL BULANDSHAHR 203001	
Contact No.	:	7417114288	
Date of Sampling	:	21/04/2025	Sample Code: 20
Sample Description	:	22/04/2025	
Quantity	:	1	Water Source RO Water
Packing details	:		Sampling Method As per IS 17614:Part-2021
Analysis Start	:		Analysis Completion Date
Temperature	:	25.8°C	Humidity 63 %
Water Sample Provided By NISHANT SINGH			
Availability of Equipments:		Availability of reference standards:	Adequacy of sample quantity 01
Availability of Test method:	IS 3025	Availability of Trained person:	Duration of testing/Time of Report release 01:15a m

TEST PARAMETER

S. N.	Test Parameters	Method	Specification		Result	(Unit)
1	pH	IS 3025 (Part 11):2017	6.5-8.5	No Relaxation	7.020	-
2	Turbidity	IS 3025 (Part 10):2017	1.0	5.00	3.165	(NTU)*
3	TDS	IS 3025 (Part 16):2017	500	2000	441	(Mg/L)*
4	Chloride	IS 3025(Part 32): 2019	250	1000	110	(Mg/L)*
5	Total Alkalinity	IS 3025 (Part 23):1986	200	600	390	(Mg/L)*
6	Total Hardness	IS 3025 (Part 21):2019	200	600	345	(Mg/L)*
7	Colour	APHA 23 rd Edistion	5	15	11	Hazen
8	Taste	IS 3025 (Part 8) : 2017	Agreeable	Qualitative	Agreeable	Qualitative
9	Odour	IS 3025 (Part): 2018	Agreeable	Agreeable	Agreeable	Agreeable
10	E-Coli		0.0	No Relaxation	0.0	-
Remark		"The Information regarding sample collected, submitted and Customer basic details provided by the customer itself."				

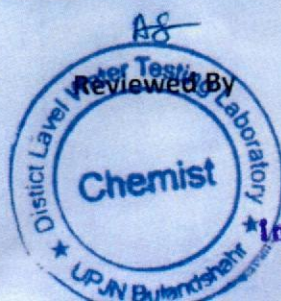

Principal
Saint Momina School
Imliya, Bulandshahr (U.P.)

Shamir Shah
Manager
Saint Momina School
Bulandshahr
End of Report

